


Certificate of Analysis

Sterile Research Diluent 30 mL


Report To:
Kimera Chems LLC
30 N Gould St STE 41270
Sheridan WY 82801
219-488-9618

Compound: Sterile Research Diluent
Amount: 30 mL
Laboratory ID: V260108-24 012
Lot Number: KC-SRD3-02
Date Reported: 1/27/2026

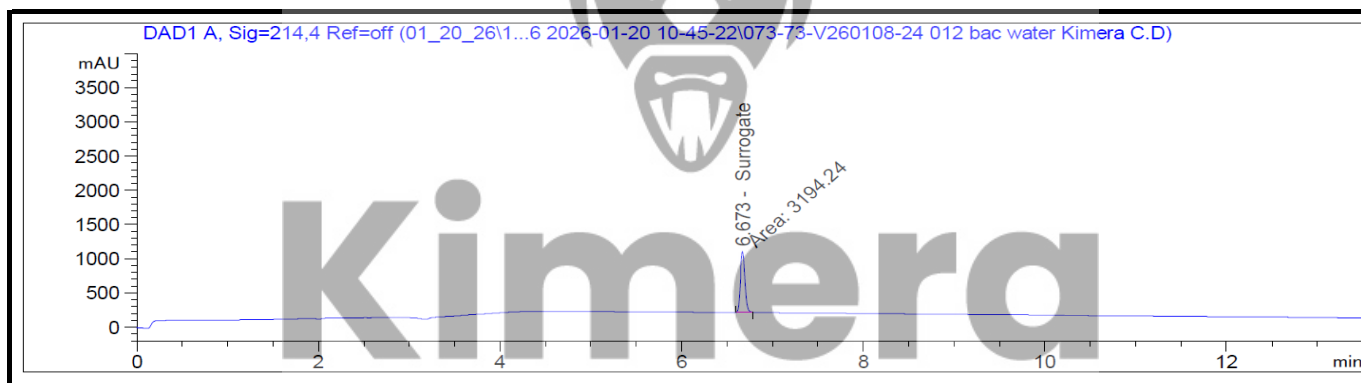

Analysis	Method	Result	Acceptable Range	Pass/Fail
Benzyl Alcohol Content	HPLC-UV/VIS	0.88%	0.72%-1.08%	Pass*
pH	AOAC 981.12	6.46	4.0-7.0	Pass*
Sterility	USP <71>	Neg.	Neg. for Growth	Pass*

* Pass/Fail according to US Pharmacopeia <1231> limits.

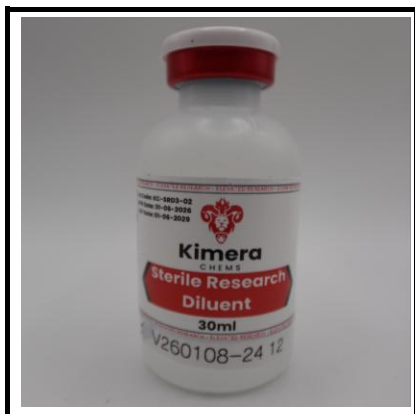


Report By: Dustin Newman, Laboratory Director on 1/27/2026



Approved By: Tori Johnson, Operations Manager on 1/27/2026



Please consult A2LA Certificate #6377.01.01 for a list of accredited tests. Samples were received in acceptable condition. The result(s) in this report relate only to the portion of the sample(s) tested. All analyses were performed consistent with the Vanguard Laboratory Quality Management System. Vanguard Laboratory and its staff did not observe or participate in the sample selection process, and cannot confirm the authenticity of the sample or its representativeness of the associated lot/batch.